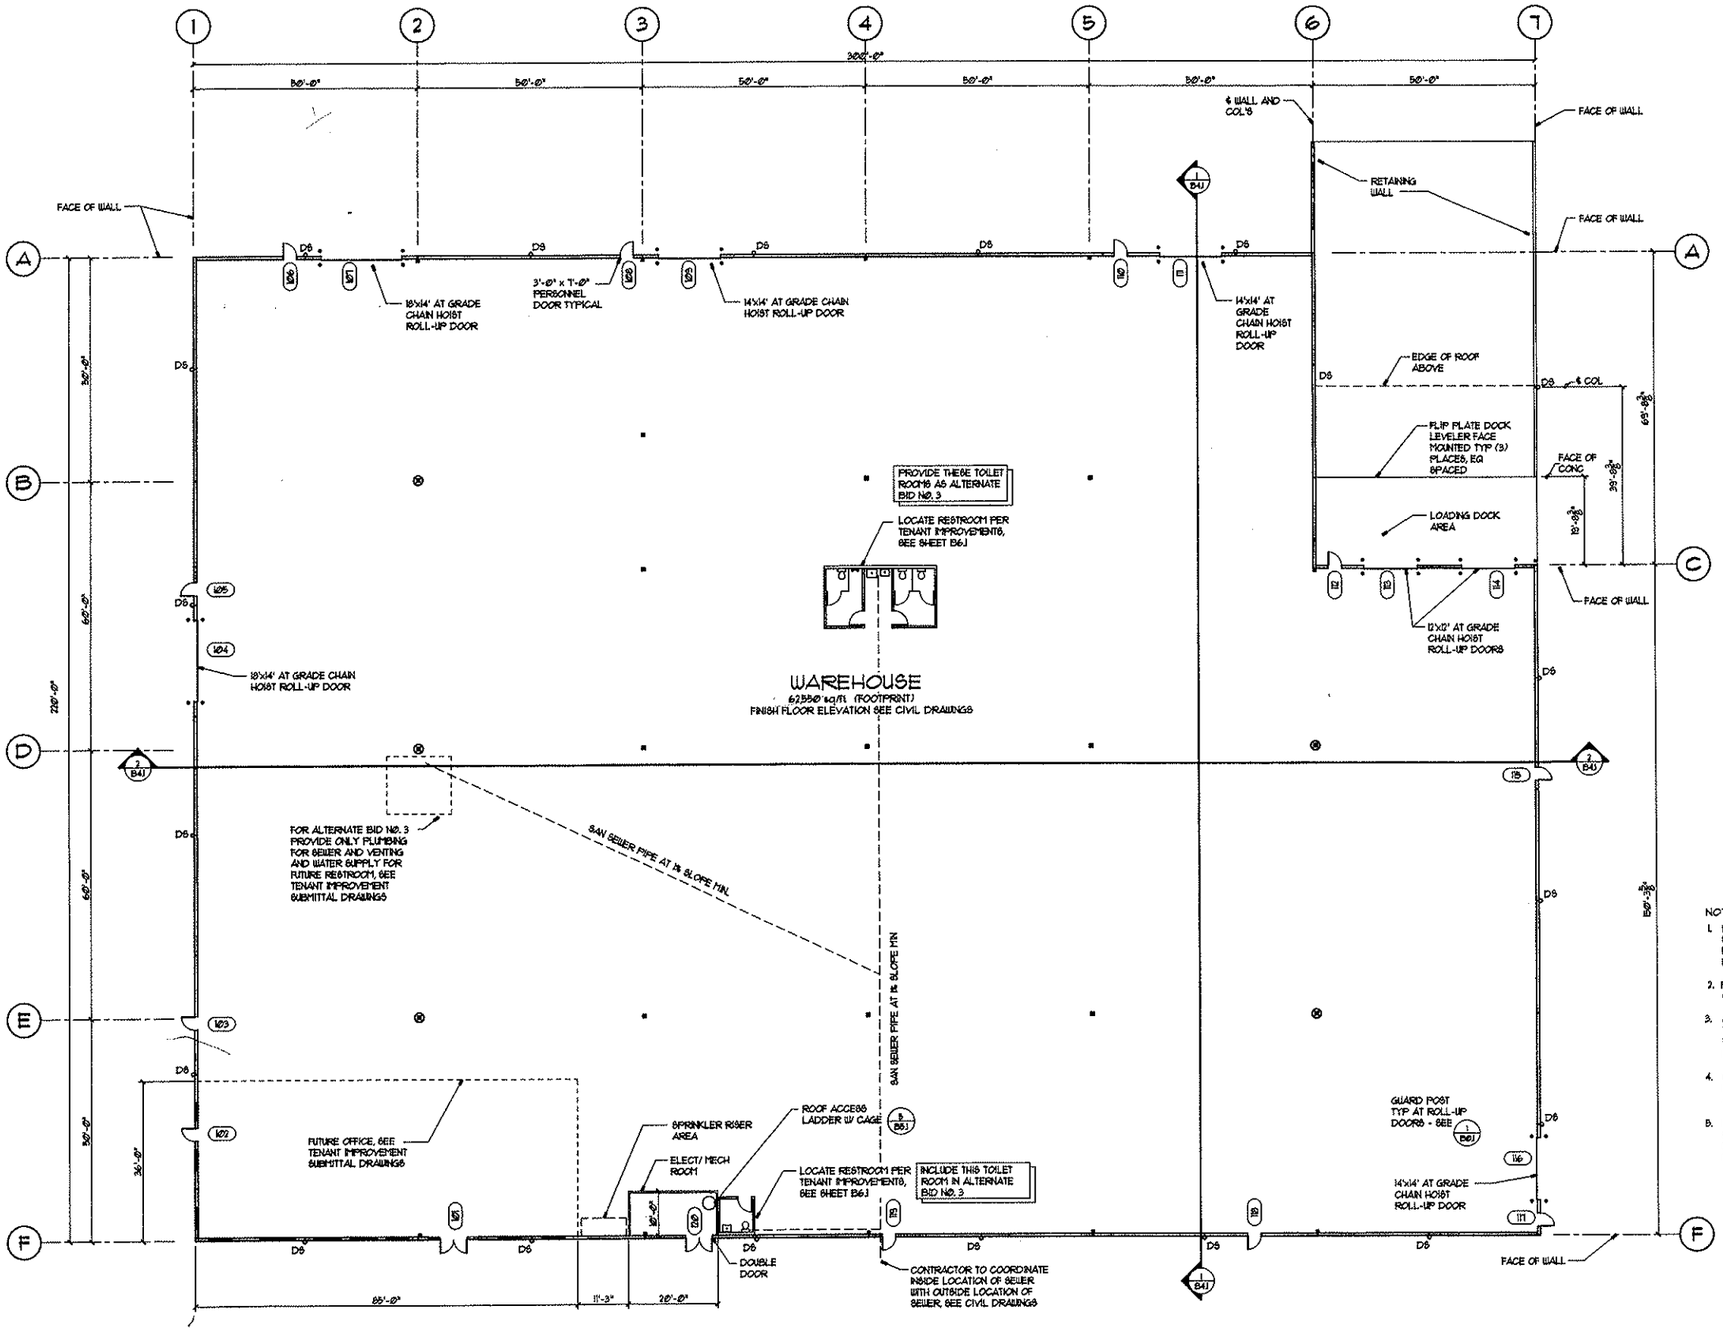

NOTES:

1. PROVIDE SIGNAGE INDICATING ACCESSIBLE UNISEX FACILITY. ADDITIONAL RESTROOMS FOR TENANT IMPROVEMENTS WILL BE ADDRESSED WITH "TI" APPLICATION FOR PERMITS.
2. PROVIDE STEEL ACCESS LADDER W/ SAFETY CAGE TO ROOF IN ELECTRICAL ROOM.
3. ALL EXITS SHALL BE ILLUMINATED AT ANY TIME THE BUILDING IS OCCUPIED WITH LIGHT HAVING INTENSITY OF NOT LESS THAN ONE FOOT CANDLE AT FLOOR LEVEL. FIXTURES FOR EXIT ILLUMINATION SHALL BE SUPPLIED FROM SEPERATE SOURCES OF POWER BY NOTE 5.
4. THE POWER SUPPLY FOR EXIT ILLUMINATION SHALL NORMALLY BE PROVIDED BY PREMISE'S WIRING SYSTEM. IN THE EVENT OF ITS FAILURE, ILLUMINATION SHALL BE AUTOMATICALLY PROVIDED FROM AN EMERGENCY BATTERY BACK-UP SYSTEM.
5. EXIT SIGNS SHALL BE INSTALLED ABOVE ALL EXIT DOORS. SIGNS SHALL BE INTERNALLY OR EXTERNALLY ILLUMINATED BY TWO ELECTRIC LAMPS. CURRENT SUPPLY TO ONE OF THE LAMPS SHALL BE PROVIDED BY THE EMERGENCY BATTERY BACK-UP SYSTEM.

NOTES:

(XX) - INDICATES DOOR SCHEDULE CALLOUT SHT B6.1

FLOOR PLAN

1/32" = 1'-0"

1

PROJECT NORTH

ISSUED FOR BID
5/14/02

AHBL
CIVIL & STRUCTURAL ENGINEERS & PLANNERS
AS SURVEYORS
2215 North 30th Street, Suite 300, Tacoma, WA 98403
Phone: (253) 383-2112 Fax: (253) 383-2572 www.ahbl.com

Revision:	Int.	Date:

PAUL B. McCORMICK
STATE OF WASHINGTON
EXPIRES 6/4/02
PROFESSIONAL ENGINEER

Stamp

REUSE OF DOCUMENTS
THIS DOCUMENT, AND THE IDEAS AND DESIGNS INCORPORATED HEREIN, AS AN INSTRUMENT OF PROFESSIONAL SERVICE, IS THE PROPERTY OF AHBL AND SHALL NOT BE REPRODUCED IN WHOLE OR IN PART, FOR ANY OTHER PURPOSE, WITHOUT THE WRITTEN AUTHORIZATION OF AHBL.

Project:
The Hillstrom Building
Shell Permit
Floor Plan

Client:
Hillstrom Ventures, LLC
102 Emery Avenue North, South Prairie, WA 98385
Phone: (360) 897-8818

Scale: As Noted
Designed: JKC/PBM
Drawn: JKC
Checked: PBM
Date: 3/20/02

Job No. 201354.00

Sheet No.
B1.1
of Sheets